


INSTALLATION MANUAL

W-GV 4 Scalino genverter OUTDOOR for mobile and land-based use



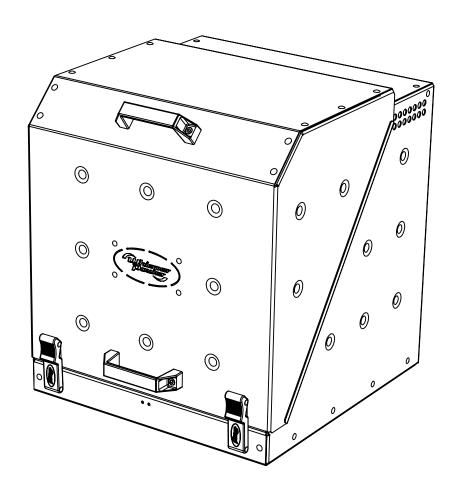

CONTENTS

1	INTRO	INTRODUCTION3					
	1.1	Use of this manual	3				
	1.2	Validity of this manual	3				
	1.3	Installation parts					
	1.4	Genverters on vehicles					
_			_				
2		LATION					
	2.1	General					
	2.2	Location					
	2.3	Protection against dirt, sand and bad weather conditions					
	2.4	Sound and vibration reduction					
	2.4.1	Further recommendations					
	2.5	Ventilation					
	2.6	Connections					
	2.7	Fuel supply					
	2.7.1	Fuel tank					
	2.7.2	Fuel lift pump					
	2.7.3	Fuel pipes	6				
	2.7.4	Fuel filters	6				
	2.8	Radiator cooling	6				
	2.8.1	General instructions	6				
	2.8.2	How and where to mount the radiator	6				
	2.8.3	Bottom-mounted radiator	6				
	2.8.4	Side-mounted radiators	7				
	2.8.5	Roof-mounted radiators	7				
	2.9	Dry exhaust system	7				
	2.9.1	General remarks	7				
	2.9.2	The standard dry exhaust system	8				
	2.9.3	Installation of the exhaust	8				
3	FLECTR	RICAL INSTALLATION	q				
•	3.1	Engine control system					
	3.2	Starter battery					
	3.3	Other recommendations and warnings					
	3.4	Alternating current					
	3.5	-					
	3.5 3.6	Cable protection (fuses)					
	3.7						
	-	Cable Connecting the Power Module					
	3.8						
4	INSTAL	LATION SUMMARY	11				
	4.1	General	11				
	4.2	Commissioning table	11				
	4.3	Technical data	11				
	4.4	Specification of the accessoiries	11				
	4.5	Fuel kit	12				
	4.6	Battery installation kit					
	4.7	Exhaust kits					
	4.7.1	Compact exhaust kit using combined muffler					
	4.7.2	Traditional exhaust kit using separate absorption and resonance mufflers					
	4.8	12VDC radiator kit					
_	DIAGE	AMS & DRAWINGS	16				
5							
	5.1	System diagrams					
	5.2	Mechanical drawings					



1 INTRODUCTION

1.1 USE OF THIS MANUAL

This manual serves as a guideline for the safe and effective installation of the WhisperPower single-cylinder genverters for mobile applications.

It is obligatory that every person who is involved with the installation of the genverter must be completely familiar with the contents of this manual, and that he/she carefully follows the instructions contained herein.

To ensure reliability and durability of the equipment, it is very important that the installation is carried out with the utmost care and attention. To avoid problems, such as temperature problems, noise levels, vibration, etc. the instructions set out in this manual must be followed and all installation work must be carried out only by qualified, authorized and trained personnel, consistent with the locally applicable standards and taking into consideration the safety guidelines and measures (Chapter 2 of the user's manual).

The information, specifications, illustrations and statements contained within this publication are given with our best intentions and are believed to be correct at the time of going to press.

Our policy is one of continued development and we re-serve the right to amend any technical information without prior notice.

Whilst every effort is made to ensure the accuracy of the particulars contained within this publication neither the manufacturer, distributor, or dealer in any circumstances shall be held liable for any inaccuracy or the consequences thereof.

Keep this manual in a secure place!

1.2 VALIDITY OF THIS MANUAL

All of the specifications, provisions and instructions contained in this manual apply solely to standard versions of the single cylinder genverters delivered by WhisperPower.

This manual is valid for the following models:

Part no.	Description
49012020	single-cylinder genverter (WP1) for outdoor
43012020	use in mobile and land-based installations

Refer to the user's manual for identification of the generator set. For other models see our website: www.whisperpower.com.



WARNING!

During installation and commissioning of the genverter, the Safety Guidelines & Measures are applicable at all times. See Chapter 2 of the user's manual.



WARNING!

A warning symbol draws attention to special warnings, instructions or procedures which, if not strictly observed, may result in damage or destruction of equipment, severe personal injury or loss of life.



DANGER!

This danger symbol refers to electric danger and draws attention to special warnings, instructions or procedures which, if not strictly observed, may result in electrical shock with possibly severe personal injury or loss of life.



WARNING!

Before working on the system read the safety instructions in the user's manual.

1.3 INSTALLATION PARTS

Besides the parts that are included with the delivery you need at least the parts listed in 4.4 to install the genverter. Please note that this listing may not be complete, as every installation differs from the other. Oil is not included in the supply. Refer to the user's manual for the right specifications.

1.4 GENVERTERS ON VEHICLES

On vehicles the engine is cooled by an external radiator with an electric driven fan. The fan can mounted be in the side or on top of the vehicle, or below it.

The exhausts recommended by WhisperPower are of the dry type and include a stainless steel flexible bellow and high quality mufflers. The exhaust can be below, in the side or on top of the vehicle, too.

IT IS VERY IMPORTANT TO EVALUATE ALL PRO'S AND CONT'S BEFORE MAKING A CHOICE HOW TO SET UP THE INSTALLATION.



2 INSTALLATION

2.1 GENERAL

To ensure reliability and durability of the equipment, it is very important that the installation is carried out with the utmost care and attention. To avoid problems, such as temperature problems, noise levels, vibration, etc. the instructions set out in this manual must be followed and all installation work must be carried out professionally.



WARNING!

The genverter incorporates powerful permanent magnets. Cardiac patients, especially those living with a pacemaker, should bear this in mind.

2.2 LOCATION

When looking for a proper place for a genverter in a vehicle all relevant aspects have to be taken into account

- Accessibility
- Solid foundation
- Presence of a compass or any other equipment likely to be influenced by magnetism
- Space to mount the radiator (refer to 2.8)
- Space to mount the exhaust (refer to 2.9)
- A route to fit the fuel lines
- The air flow through the genset (refer to 2.5)

Because of their small dimensions, WhisperPower genverters can be installed in tight locations. Please consider that even almost maintenance-free machinery must still remain accessible.

When selecting the location for the genverter, make sure there is sufficient room to carry out any maintenance work. The unit must be easily accessible on the service side. Oil filling can be done on the service side and on the top. The top of the engine (rocker cover) has to be accessible for adjustment of the valve clearance.

Please also note that in spite of the automatic oil pressure switch the oil level must checked regularly.

2.3 PROTECTION AGAINST DIRT, SAND AND BAD WEATHER CONDITIONS

The unit can be mounted below a vehicle. However, be aware of the bad conditions below a truck when driving in rain or snow. Also protect the unit from a spray of water and/or mud behind the wheels.


2.4 SOUND AND VIBRATION REDUCTION

The genverter is secured to the base frame inside the canopy by means of a flexible engine mountings system. This frame is must be solidly mounted, not using rubber mountings again.

2.4.1 Further recommendations

WhisperPower genverters are standard equipped with a sound cover canopy. This sound cover has been designed to give effective sound insulation. For optimum sound and vibration dampening, the following factors should be considered.

- 1 Most importantly, the structure on which the genverter is placed must be stiff. Directly below the base frame, the structure should be supported vertically to the chassis of the vehicle. When this is not possible horizontal structures should be made stiff by additional provisions (Figure 4).
- 2 In larger vehicles a separate and insulated space for the genverter will help to dampen the noise even further.
- 3 Avoid mounting the genverter in close proximity to thin walls or floors that may cause resonance.
- Sound dampening is extremely poor if the genverter is mounted on a light weight flimsy surface such as plywood which will only amplify vibrations. If mounting on a thinner surface cannot be avoided, this should be at least be reinforced with stiffening struts or ribbing. If possible, holes should be drilled or cut through the surface to help reduce the resonance. Covering the surrounding walls and floors with a heavy coating plus foam will certainly improve the situation.
- 5 Never connect the base of the genverter directly to walls or tanks (Figure 1).

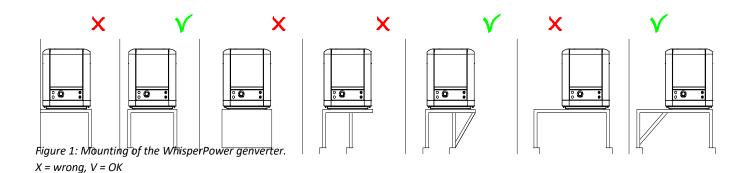



2.5 VENTILATION

When not in the open air below a truck, the genverter normally draws air from the engine compartment. An engine compartment with natural ventilation must have vent openings of adequate size and location to enable the genverter set to operate without overheating. To allow an ample supply of air within the temperature limits of the genverter an opening of at least 900 cm² is required.

A "sealed" engine compartment must have a good extraction ventilator to maintain reasonable ambient temperatures. High temperature of intake air reduces engine performance and increases engine coolant temperatures. Air temperatures above 40°C reduce the engine power by 2% for each 5°C of rise. At higher temperatures the electric output will be lower. To minimize these effects the engine room temperature must not exceed the outside ambient air temperature by more than 15°C.

Apply a combination of ventilators, blowers and air intake ducting to meet the temperature limit. The air inlet ducts should run to the bottom of the engine compartment to clear fumes from the bottom and to circulate fresh air. Air outlets should be at the top of the engine compartment to remove the hottest air. An engine compartment blower should be used as an extraction ventilator to remove air from the engine room.

In cases where it is impossible to meet the above mentioned temperature limit by using engine compartment ventilation, connections are to be made for an air inlet directly to the genverter enclosure. With these connections the genverter can be directly connected to an air duct.

Air inlets should be louvered, where appropriate, to protect the engine room and to protect the genverter from rain and water spray.

2.6 CONNECTIONS

The genverter comes with all supply lines and output cables (i.e. electric cables, exhaust connection, fuel lines etc.) already connected. The supply lines are fed through the capsule's front base. The connections are marked as shown in Figure 2.

Refer to Section 5.1 for a graphical overview of installation and wiring connection requirements.

All electrical connections, cable types and sizes must comply with the appropriate national regulations.



ATTENTION!

Before working on the system, read the safety instructions.

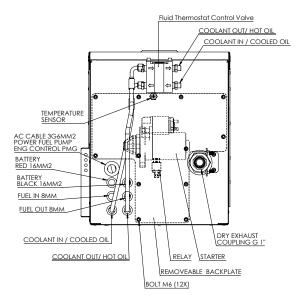


Figure 2: Genverter connections

2.7 FUEL SUPPLY

2.7.1 Fuel tank

Fuel tanks should be made of appropriate material such as (stainless) steel or plastic. Steel tanks should not be galvanized or painted inside. Condensation can occur in metal tanks when temperature changes. Therefore, water accumulates at the bottom of the tank and provisions should be made for the drainage of this water.

The tank will need a filling connection, a return connection and an air ventilation connection which will require protection against water entry.

Some official regulations do not allow connection points at the base of the fuel tank; connections are to be made at the top of the tank with internal tubing down to a few cm above the bottom of the tank. When using the existing fuel tank of the car engine, fitting should be carried out with extra care. Both a supply line and a return line should be installed and go into the tank from the top. Interference of the two systems (car engine and genverter engine) should be avoided. Driving the tank empty below the level of the suction pipe of the genverter could make it necessary to bleed the fuel system.

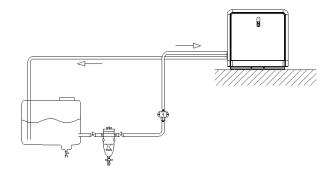


Figure 3: Fuel tank below the genverter



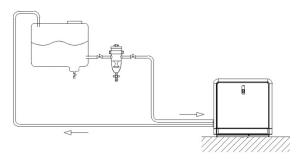


Figure 4: Fuel tank above the genverter

2.7.2 Fuel lift pump

All models are fitted with an external fuel lift pump. This should be mounted close to the tank, in an angle or vertically to prevent air bubbles from blocking the system. As the pump makes clicking noises, it is recommended to use rubber mountings. If the clicking noises of the pump are not acceptable, a noiseless pump is available as an option (part. no. 50202200).




Figure 5: Fuel line assemblies with pump mounted vertically or in an angle

2.7.3 Fuel pipes

When the tank is above the genverter (Figure 4) we recommend ending the return line on the top of the tank. When the return is on the top, siphoning of the return line is impossible in case of a leakage. Only the fuel supply line will need to be fitted with a fuel cock. When the tank is below the genverter (Figure 3) we recommend ending the return line on the bottom of the tank below the inlet of the supply line.

Both supply and return fuel pipe lines should be made of appropriate material and have an 8 mm inner diameter. The quality of the tubing of fuel pipes may be subject to local regulations depending on the application of the vehicle.

The fuel pipes can be connected to the flexible hoses which are on the genverter and are prepared to be fitted to 8 mm pipe. The resulting fuel line complies with CE standards as well as ISO 7840 A2.

It is important to avoid bends in the pipes, as they could trap air bubbles. The return pipe should never be connected to the suction pipe. The return line should be of 8 mm diameter and go straight back via the top to the bottom of the tank. When the return is too narrow, has too many bends and goes back to the bottom of the fuel tank (i.e. bypassing the top), the back-pressure may be too high. This results in irregular running of the engine. When the engine runs irregularly, check if back-pressure is the problem by disconnecting the return line just outside the canopy and draining it in a canister. When the engine runs

smooth now, the return piping has to be changed. It could also help to install a second (electrical 12V) fuel lift pump in the supply line to increase the pressure.

2.7.4 Fuel filters

A fine fuel filter is installed which requires maintenance. WhisperPower recommends installing an extra fuel filter/ water fuel separator near the fuel tank.



Before starting your genverter for the first time follow the fuel system bleeding procedure in the user's manual.

2.8 RADIATOR COOLING

2.8.1 General instructions

The radiators can be mounted below the floor, in the side or on the roof of the vehicle. It is recommended to install the radiator as close as possible to the unit. The piping should be fitted as direct as possible.



It is very important to use good quality heat and pressure resistant hose and fittings. Therefore it is strongly recommended to use WhisperPower installation kits.

2.8.2 How and where to mount the radiator

The radiator kit includes rubber mountings to prevent vibrations from being transferred to the body of the vehicle. Due to the differences between vehicles general instructions are hard to give. For OEM customers, WhisperPower can supply a customized installation kit.

When mounting the radiator it is important to take care that the ingoing connection, which is the connection to the engine outlet, is on the top position. If not, the radiator's cooling capacity will be reduced.

2.8.3 Bottom-mounted radiator

When bottom-mounted, the radiator should not be the lowest point of the vehicle to avoid damage.

A free flow of air should be ensured. When horizontally mounted, the fan should be at the bottom side, causing a flow of air downwards. Often it is possible to find a place where extra space above the fan helps to create a free flow of air. It is recommended to fit a shield below the radiator, catching stones and dirt and operating as a spoiler. The distance between the radiator and the shield should be at least 50 mm. Sometimes it is possible to build the radiators and shield on a sub frame that is mounted below the vehicle as a module.



MEASURES HAVE TO BE TAKEN TO PREVENT THE HOT AIR FROM CIRCULATING AND REDUCING THE CAPACITY OF THE RADIATORS.






Figure 6: Bottom-mounted radiators with shield

2.8.4 Side-mounted radiators

Both effective and easy is to mount the radiator in the side of the vehicle, if possible below the level of the top of the engine. A louvered grid should protect the radiator from rain and objects, but must not block the airflow. The fan should be inwards, causing the air to blow outwards. A disadvantage of having the radiator in the side is possibly more noise from the electric fan and a flow of air that could be felt by people passing by.

A free flow of air should be ensured.




Figure 7: Side-mounted radiator

2.8.5 Roof-mounted radiators

The radiator on the roof is often the best option from the point of view of keeping the noise of the fan away from people and it will give the best result in dissipating the heat. However, this option may conflict with the possible need to keep the vehicle as low as possible.

Another disadvantage is that the piping has to go through the roof which requires connections to be made waterproof. When having the radiators horizontally mounted on the roof (Figure 8) enough space (50 mm) should be between the roof and the radiator fan to have a free flow of air. When the radiator is roof-mounted there should be protection against weather conditions. To avoid damage while the vehicle is driving at high speed, the use of a spoiler may be necessary.




Figure 8: Two examples of top mount radiators

2.9 DRY EXHAUST SYSTEM

2.9.1 General remarks

A dry exhaust muffler system should be very effective in silencing the exhaust when applying the right mufflers. However, noise could be generated by vibrations in the mufflers and be transferred to the chassis. Tacit factors like the length of specific pipe sections could cause the noise to be amplified. It is very difficult to take these factors into account.

The standard WhisperPower exhaust kit contains the materials to perform a professional installation. It includes a stainless steel flexible hose to allow for expansion and to prevent vibrations from being transferred. Rubbers are supplied to mount the mufflers flexible. Insulation jackets for the flexible hose and the resonance muffler are optionally available, and very effective in dampening vibrations. Still, additional measures may have to be taken like an extra clamp in a vibrating section of pipe, insulation blankets on other parts of the system and possibly even additional mufflers.



WHEN THE EXHAUST IS LED THROUGH THE ROOF OF A VEHICLE, MEASURES HAVE TO BE TAKEN TO PREVENT RAINWATER FROM ENTERING THE SYSTEM. SPECIAL RAIN CAPS ARE AVAILABLE AS AN OPTION.




Figure 9: Ways to prevent water from getting in



A negative feature of a dry exhaust system is the heat radiated by its components. When a dry exhaust has its outlet on the roof, all the pipes inside the vehicle have to be insulated.



The exhaust pipes will be very hot and all accessible pipes and mufflers are dangerous to people when not insulated.

Some companies specialize in insulating hot pipes, and fancy systems are available to make them look better. Alternatively, you can wind fiberglass or rock wool around the pipes and seal the insulation with aluminium tape.

2.9.2 The standard dry exhaust system

The standard exhaust system comprises:

On the genverter set:

An insulated exhaust bend

In the exhaust installation kit:

- A stainless steel flexible hose
- A combined resonance and absorption muffler
- Clamps and rubbers
- Fittings, bends and pipes to make the various connections
- Blankets for thermal and acoustic insulation (optionally available).

The mufflers are high quality industrial mufflers much more effective, robust and durable than mufflers made for automotive use.

2.9.3 Installation of the exhaust

An essential step in determining the location of the genverter is considering how install the exhaust. Usually, space can be found below the vehicle to mount the mufflers. The outlet should blow the fumes away from the doors. When the gasses are in the flow of air blowing from the radiators this will help to make the fumes less noticeable. Fumes must not be sucked into the flow of air passing through the radiators. In calm conditions, a slight smell of exhaust fumes around the vehicle is hardly avoidable.

Bringing the exhaust to the top of the vehicle gives the best results on noise and smell. However, pipes inside the vehicle should be insulated and there should be a collar around the hole in the roof to prevent the ingress of rainwater.

The mufflers should be wide apart: the resonance muffler close to the genverter and the absorption muffler on the end of the line, with at least 1 m pipe in between. A short pipe (30 cm) should be on the far end after the absorption muffler. The absorption muffler requires no particular flow direction and could be mounted both ways. The resonance muffler, however, should be mounted taking into account the indication shown on the muffler itself.



The resonance muffler should be fitted taking into account the gas flow direction indicated.

The exhaust kit contains clamps for mounting the exhaust pipes to stainless steel bars. These bars should be mounted to the vehicle chassis. It is recommended to use rubber mountings whenever possible. However, care should be taken that the heat conducted through the brackets will not affect the rubber. Figure 10 shows how to mount the rubber in a safe way. An extra safeguard in steel wire or chain may be considered.




Figure 10: Mounting bracket in rubber with safeguard



3 ELECTRICAL INSTALLATION

3.1 ENGINE CONTROL SYSTEM

Engine control (standard 12V) is incorporated in the PMG Power Module for Genverter. Use the PMG box or its remote control panel to operate the genverter.

3.2 STARTER BATTERY

For starting, the genverter requires a 12V/55 Ah starter battery.

We strongly recommend the use of a separate battery for the genverter and keeping the wiring system for the car engine and the domestic DC supply system completely separate and individually connected to separate batteries.

However, the negatives of all the batteries on the vehicle should be interconnected to avoid difference in the voltage level of the earth on different places causing trouble to electronic devices which might be in the system.

The above recommendation is not valid for vehicles having the starter battery of the vehicle engine or other auxiliary equipment positive grounded. When this is the case an expert should be consulted.

The starter battery is charged by the alternator on the engine. However, when the genverter is not used for an extended period of time, its control system may eventually drain the starter battery. The WhisperPower catalogue (check www.whisperpower.com) offers several solutions to prevent this from happening:

- A battery switch may be installed to interrupt the positive connection.
- An AC-supplied battery charger may also help to keep the battery in good condition when the genverter is not used (see also battery installation kit).
- WhisperPower also offers high efficiency battery charging units which are able to charge both the vehicles's main battery and the starter battery.

3.3 OTHER RECOMMENDATIONS AND WARNINGS

The battery should be secured for poor road conditions and the terminals should be insulated. For extra safety the battery can be enclosed in a wooden, plastic, fiberglass etc. (non metal) box. Even when the earth return system is applied a negative battery cable should be used and the vehicle should not to be used as a conductor.

The battery cables are supplied in a standard length of 1.5 m. If longer cables are required a larger cross sectional area should be considered to compensate for voltage reduction.



When two batteries are used in series to provide a 24 Volt supply system, never take off 12 Volt (starting) power from one of these batteries. This will result in severe damage to both batteries within a short time.

Disconnect the battery leads if electrical welding is to be carried out, otherwise damage will be caused to the diodes of the alternator.



As explosive hydrogen gases may be discharged during charging, the battery should be located in a well-ventilated space. Ensure that the supplied battery cable connectors are properly fitted. Never remove these during or shortly after charging, as sparking may occur, igniting the hydrogen gases.

3.4 ALTERNATING CURRENT



The electric power supplied by the genverter is of a high voltage and dangerous to people. Before working on the system read the sections on safety in the users manual.



Be aware that people are not used to have AC available on a vehicle. Put warning signs on wall sockets and on junction boxes. Instruct non-regular users of the vehicle. Warn maintenance personnel of garages that do service on the vehicle.



Generators used on vehicles that are operated in a hazardous environment often have to fulfil special regulations and additional measures have to be taken accordingly.

These genverters are designed to generate power for both AC and DC installations, depending on the type of WhisperPower PowerCube or Power Module installed with the genverter. Be sure that all electrical installations (including all safety systems) comply with all regulations required by the local authorities. All electrical safety/shutdown and circuit breaking systems have to be installed on board as the genverter itself cannot be equipped with such equipment for every possible variation.

The vehicle's power supply system should be suitable and safe for the voltages applied and the power that will be generated. Special attention has to be paid on dividing the system in branches which are fused individually.

It is absolutely essential that each and every circuit in the electrical system be properly installed by a qualified electrician.

3.5 CABLE PROTECTION (FUSES)

It is the installer's responsibility to protect the live wires between the genverter and the PMG/DC PowerCube. Check the electrical information on the identification plate in order to calculate the right fuse size.

Please note that the above is in addition to any fuses required between the PMG/DC PowerCube and the AC installation or batteries, as applicable.

3.6 GROUNDING

The AC alternator windings are not grounded.

The housing of the alternator and all other metal parts are grounded to the base plate by means of a braided strap. Assuming that the sound shield is bolted to a metal surface, this should provide adequate grounding. In case of doubt, an additional grounding cable should be connected.



The electric installation in the vehicle possibly needs to be protected against insulation failures. Methods of protection are subject to rules that may differ depending on the use of the vehicle and local standards. Experts in this field should be consulted.

3.7 CABLE

For the power cable we recommend the use of 3 wire single phase oil resistant cable with a sufficient cross sectional area. For long cables it is recommended to apply cables with a larger cross section (refer to ISO 13297 annex A).

3.8 CONNECTING THE POWER MODULE

Refer to the WP-PMG Owner's Manual for instructions as to installing and connecting the 230VAC power module.



4 INSTALLATION SUMMARY

4.1 GENERAL

- 1 Mount the genverter directly, without additional vibration dampers, on a solid surface.
- 2 If applicable, mount the separate cooling system.
- 3 Connect exhaust system.
- 4 Connect 'fuel supply line' to the water separator/ fuel filter.
- 5 Connect 'fuel return line' to the fuel tank.
- 6 Connect remote panel (just plug in).
- 7 Connect the AC cables to the PMG/DC PowerCube.
- 8 Connect the battery cables to the 12V starter battery's positive and negative terminals.
- 9 If applicable, connect the power supply of the external radiator.
- 10 Install a WhisperPower battery charger (optional).

4.2 COMMISSIONING TABLE

- 1 Check if the air inlet is sufficient.
- 2 Check if the cooling system for the engine is properly installed and properly filled with oil.
- 3 Check if the exhaust system is properly installed. Check maximum length of exhaust hose, diameter of exhaust piping.
- 4 Check all cooling oil connections.
- 5 Check the AC cables and the grounding.
- 6 If the genverter is installed with a WP-PMG, check if an AC breaker is installed before or after the power source selector. When there is only a circuit breaker, use it to disconnect the generating set from the grid.
- 7 Check all DC connections, check if the battery switch/ circuit breaker is closed.
- 8 Open the fuel valve. Check if there are no air leaks in the fuel supply line, and check if the lift of the fuel is less than 1 m. Check if there is no air in the water fuel separator.

- 9 Check the oil level.
- 10 To bleed the fuel system, push the "Start" button on the local control (not on the remote panel) and hold at least 5 s and as long as necessary to bleed the system.
- 11 Start the engine by pushing the start button.
- 12 If the genverter is installed with a WP-PMG, check the delay of 5 to 10 seconds in the power source selector transfer.
- 13 Check voltage under 'no load' conditions.
- 14 Check if the genverter can bring the full load.
- 15 Check if the battery charger of the genverter is working (max. 14.5 V).
- 16 Close the sound shield and check the noise level.
- 17 Stop the genverter and check the engine again for leakages of oil or fuel and check the oil level again.

Installation checklist available on our website: www.whisperpower.com.

Commissioning form supplied with the genverter, also available on our website: www.whisperpower.com.

4.3 TECHNICAL DATA


Refer to the User's Manual for an overview of general technical specifications.

4.4 SPECIFICATION OF THE ACCESSOIRIES

Fuel filter/water separator	30 micron
Fuel inlet and return	8 mm
Flexible exhaust hose	1"BSP
Exhaust piping	1"
Exhaust mufflers	1"BSP
Starter battery	55 Ah



4.5 FUEL KIT



no	qty	article no	description dimensions		
42	1	50230091	Filter head for fuel strainer/water separator M14x1.5 mm		
43	2	50221618	Parallel male coupling M14 - 8 mm		
44	2	50221619	Parallel male coupling	Parallel male coupling M14 - 10 mm	
45	2	50221620	Hose connection, outer cone M16x1.5 mm, 8 mm		
46		50230092	Filter for fuel strainer/water separator		
48	4	50221522	Hose clamp, stainless 10-16 mm		
49	2	50221632	Gasket ring 18x14x1.5 mm		
not shown	2	50221203	Straight coupling 8 mm		
not shown	2	50221252	Barbed-smooth hose nipple 8 mm		
TOTAL		40230205	FUEL KIT	·	

OPTIONAL MATERIALS AVAILABLE

no	qty	article no	description	dimensions
48	50221522 Hose clamp, stainle		Hose clamp, stainless	10-16 mm
not shown	per m	50222020	copper fuel pipe	6x8 mm
not shown	per m	50220063	fuel hose	8x16 mm

4.6 BATTERY INSTALLATION KIT

BATTERY INSTALLATION KIT

article no	description	dimensions	
61112002	WBC-Handy 70 charger 12V / 7A 225 × 50 × 50 mm		
40290093 battery terminal (NEG-)			
40290094	battery terminal (POS+)		
40290099	1290099 M8 battery pole adapter set		
40290098	isolation caps (red & black)		
50214701 WP-Compact Manual Battery Switch, 300A 72 x 72 x 78 mm			
40290108	BATTERY INSTALLATION KIT		

RECOMMENDED BATTERY

article no	description	dimensions
40290061	AGM-Power 12V 55Ah Absorbed Glass Matt	229 x 138 x 210 mm



4.7 EXHAUST KITS


4.7.1 Compact exhaust kit using combined muffler



qty	article no	description		
4	50201131	Anti-vibration mount, 30×25 55shore M/F		
4	50211120	Hexagonal bolt, M8×10 stainless A2		
4	50211419	Washer, M8 stainless		
4	50211498	Self-locking nut, M8×10 stainless A2		
1	50220044	Flexible exhaust pipe, 680mm stainless 1"G M/M		
1	50221429	Union, 1" stainless (not shown)		
4	50221678	Fibre washer, 8×16mm		
1	50230630	Combined absorption and resonance muffler, stainless		
TOTAL	40201326	1" DRY EXHAUST KIT /w COMBINED MUFFLER		



4.7.2 Traditional exhaust kit using separate absorption and resonance mufflers

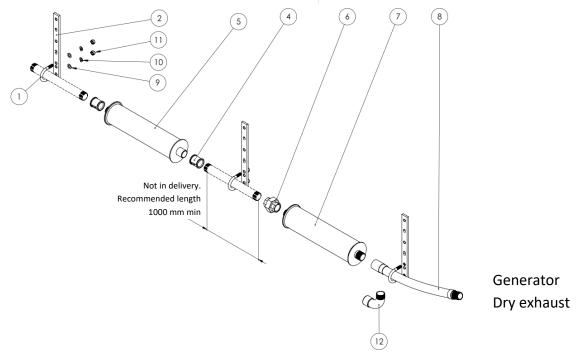


no	qty	article no	description		
1	3	50221661	U-bolt M10		
2	3	50221664	Tail bracket 250 mm M10 42-60mm		
4	2	50221411	Socket F/F		
5	1	50230609	Absorption muffler		
6	1	50221421	Union F/F		
7	1	50230610	Resonance muffler		
8	1	50220041	Stainless steel flexible exhaust pipe F/M		
9	6	50211406	Washer M10		
10	6	50211447	Spring washer		
11	6	50211466	Nut M10		
12	1	50221471	Bend M/F 1		
TOTAL		40201325	1" DRY EXHAUST KIT		

OPTIONAL MATERIALS AVAILABLE

no	qty	article no	description	dimensions
not shown		40201324	Insulation blanket kit	



4.8 12VDC RADIATOR KIT

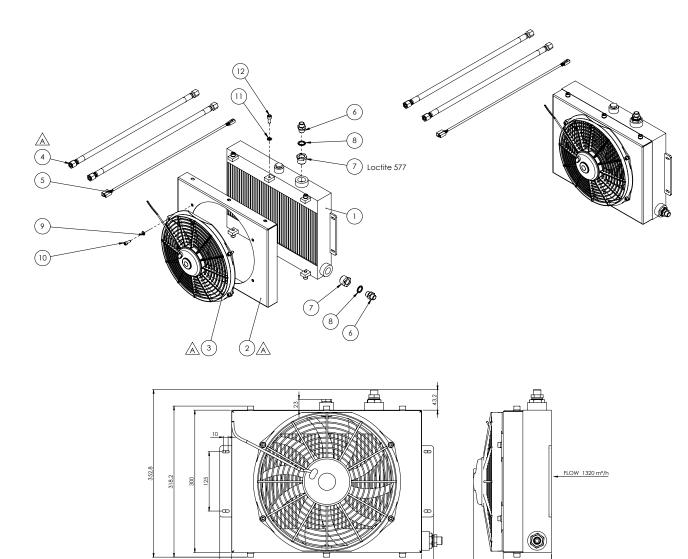

Fan ø280 12V 1320m3/h 6,4Amp

no	qty	article no	description
12	6	50211231	Binnenzesk M8x18
11	6	50211445	Washer Spring SP M8
10	4	50211226	Hexagon Socket Head Screw ZP 8.8 M6X16
9	4	50211404	Subject Ring VZ M6
8	2	50211426	Sealring sensor M16
7	2	50221105	Verloopring 3-4 3-8
6	2	50221693	Nipple straight GE 10L 3/8" NPT
5	1	40401013	Cable I=3000mm fan oil cooler kit GV4
4	2	40201027	Oil L=3000 tbv Radiator Oil Cool kit 40201318
3	1	50230358	Axial Fan VA09-AP-C-54A
2	1	50230346	Air duct fan 280mm
1	1	50230380	Radiator Element 300x400
TOTAL		40201318	12VDC RADIATOR KIT



5 DIAGRAMS & DRAWINGS

5.1 SYSTEM DIAGRAMS

NOTE: A4-size drawings can be downloaded from www.whisperpower.com.

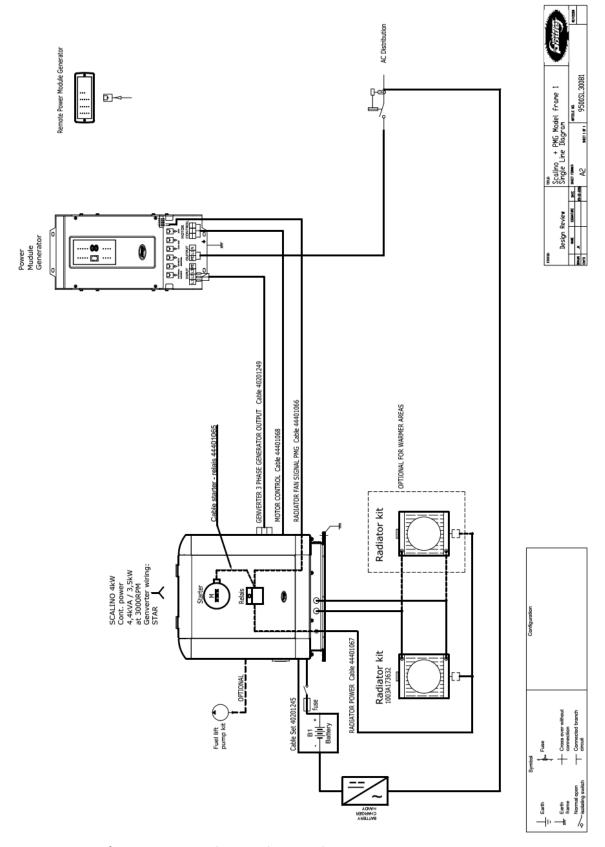


Figure 11: Layout of genverter system with PMG and 12VDC radiator



5.2 MECHANICAL DRAWINGS

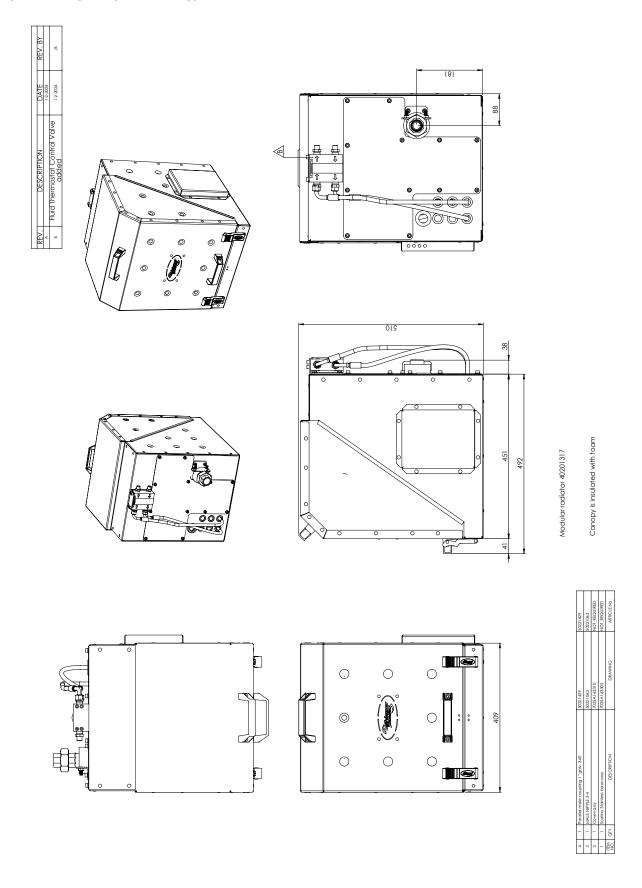


Figure 12: Dimensions



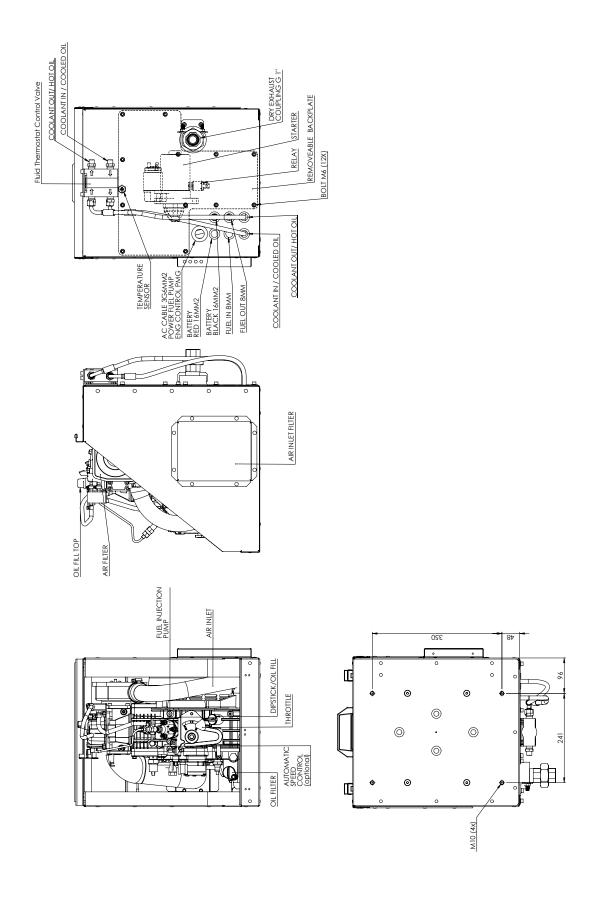


Figure 13: Main components and mounting rectangle



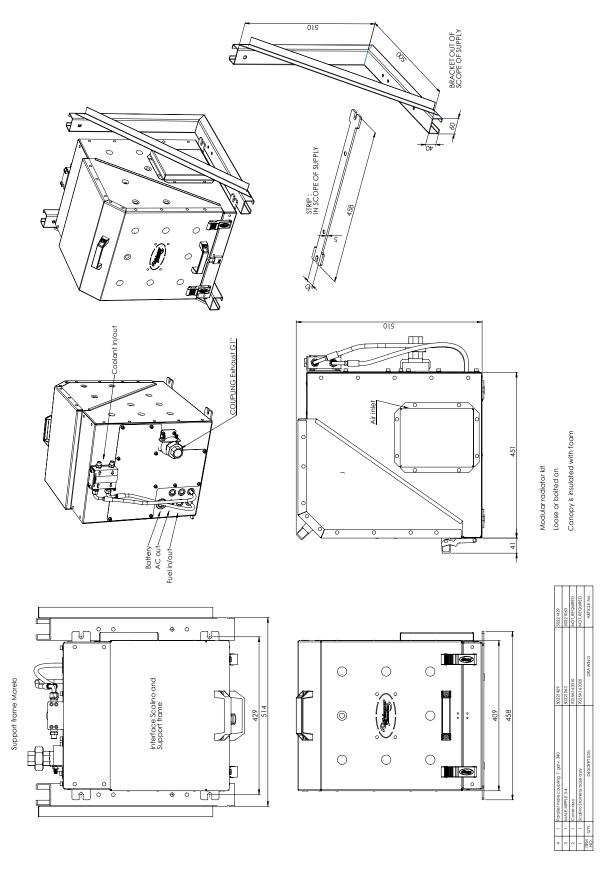


Figure 14: Example of installation using brackets



Kelvinlaan 82, 9207 JB Drachten, Netherlands www.whisperpower.com / sales@whisperpower.com